


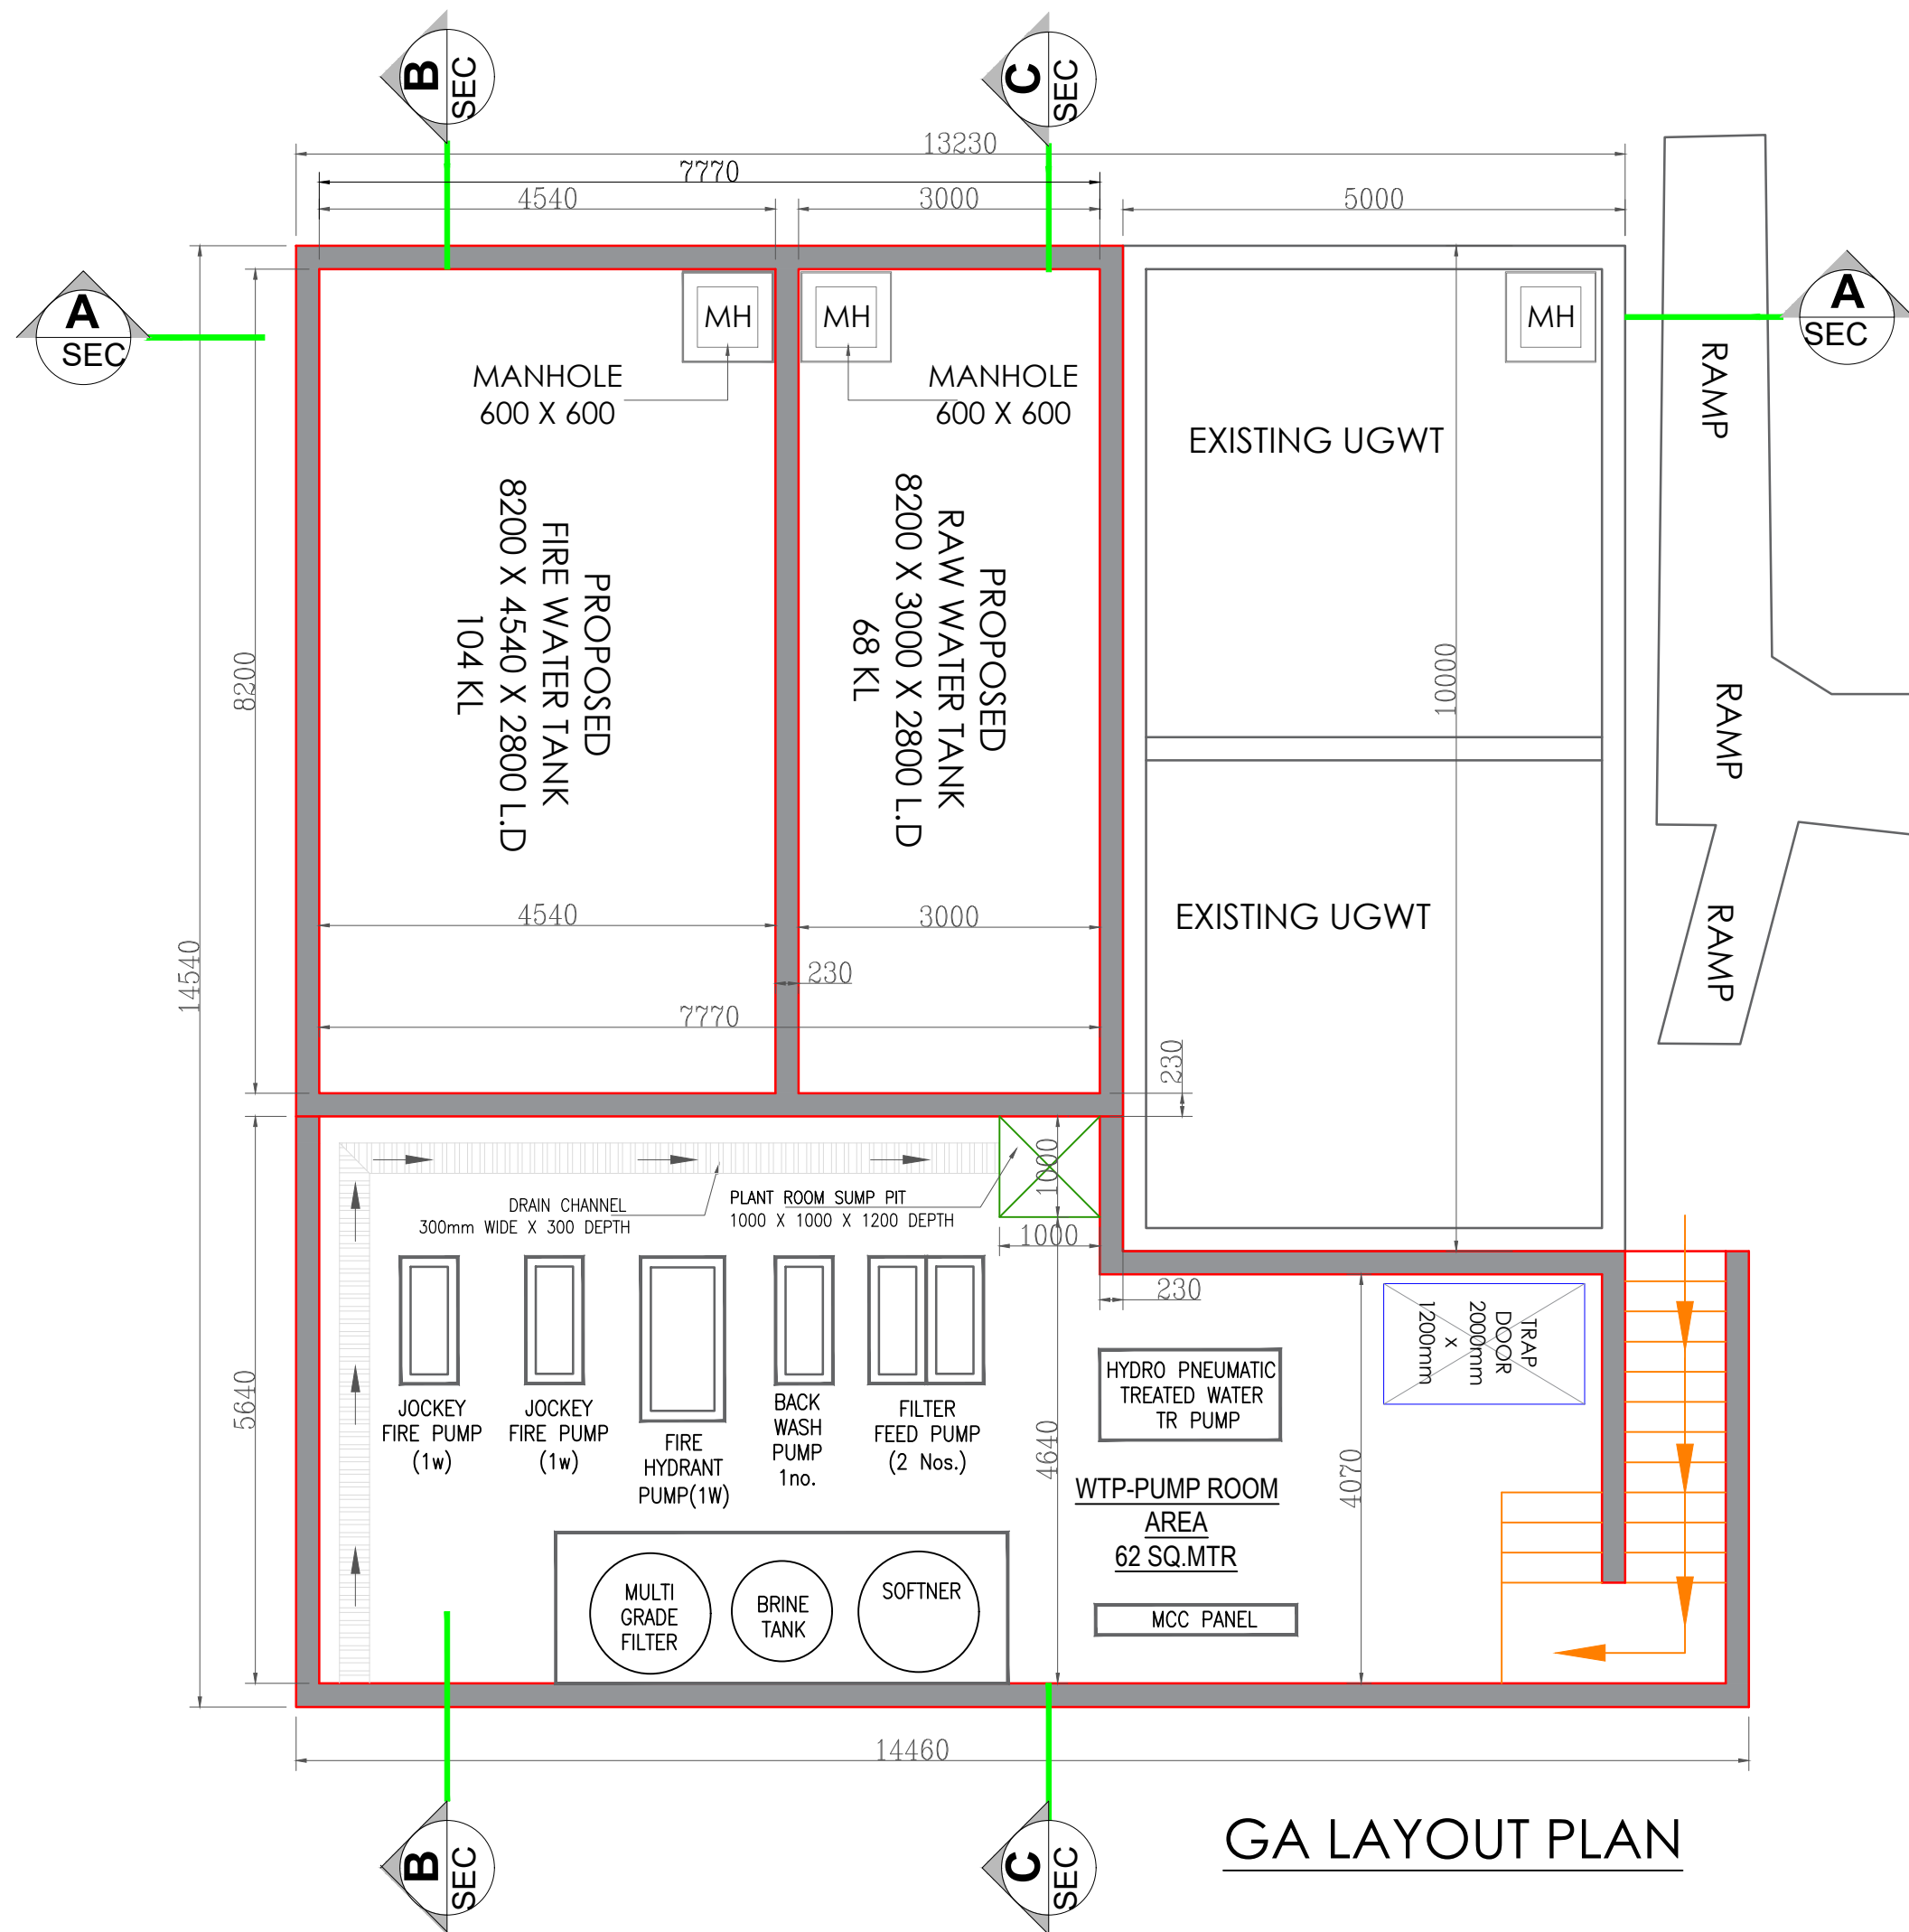

GA LAYOUT PLAN

PROPOSED NEW TANKS			
01.	FIRE WATER TANK	8.2 X 4.54 X 2.8 L.D	104 KL
02.	RAW WATER TANK	8.2 X 3.0 X 2.8 L.D	68 KL
03.	PLANT ROOM SUMP PIT	1.0 X 1.0 X 1.2 DEPTH	-

04. Treated Water Tanks - 5 M x 5 M x 2 M (D) X = 100 KL

EQUIPMENT DETAILS		
01.	JOCKEY FIRE PUMPS	2 NOS.
02.	FIRE HYDRANT PUMP	1 NOS.
03.	FILTER FEED PUMPS	2 NOS.
04.	HYDRO PNEUMATIC TREATED WATER TRANSFER PUMPS.	2 NOS.
05.	MULTI GRADE FILTER	1 NO.
06.	BRINE TANK	1 NO.
07.	SOFTNER	1 NO.

06-12-2025	R2	J.G	V.R	
01-12-2025	R1	J.G	V.R	
22-11-2025	RO	J.G	V.R	
DATE	REVISION	CHECKED	DRAWN	COMMENT
PROJECT : IIC - WTP-GA LAYOUT PLAN				
DRAWING NO: 02 / AZ / WTP / GA / 11 / 25			SIZE	NTS
DRAWING TITLE : WTP - GA LAYOUT PLAN				
 AZTEK PVT. LTD. A to Z Technologies D-52, Sector 2, Noida-201301(U.P) E-mail : aqua@aztekindia.com				